


[Home](#) ■ [HUBER Report](#) ■ [Stainless\\_Steel](#) ■ [Drinking Water Storage](#) ■ [New drinking water reservoir for the town of Senden](#)

## New drinking water reservoir for the town of Senden

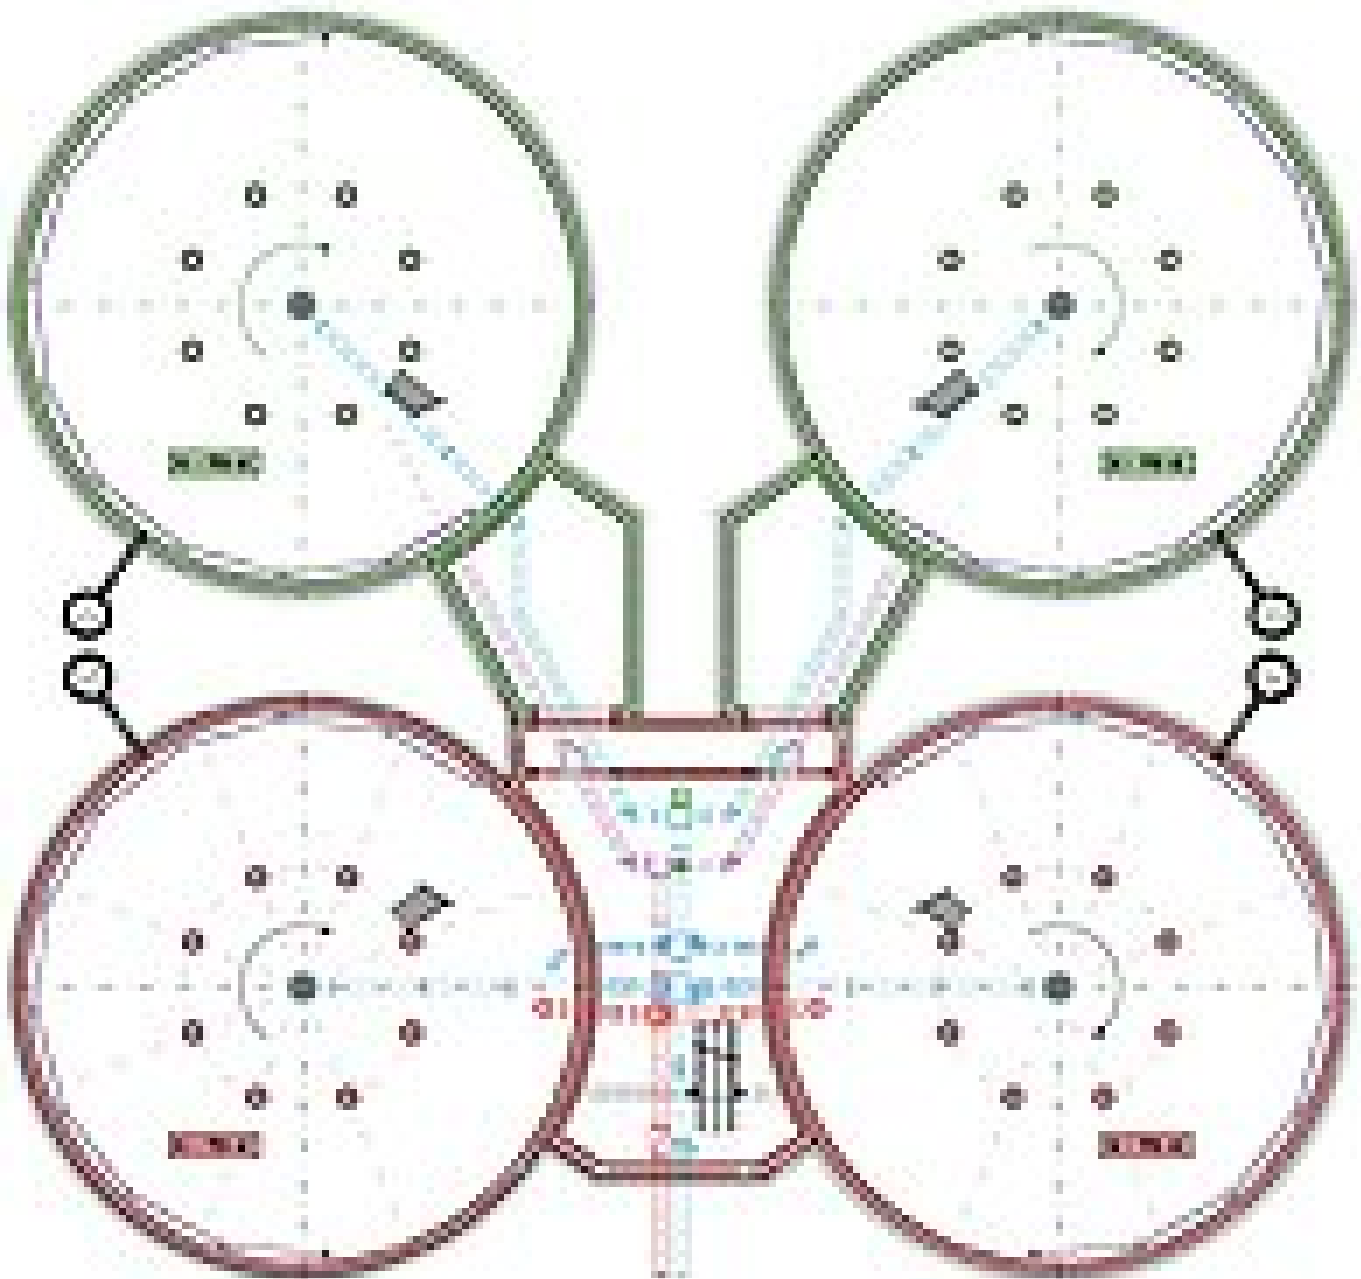

*Footprint of the new elevated tank in Witzighausen*

Senden has 23,000 inhabitants, the town's average yearly drinking water consumption is 1,300,000 m<sup>3</sup>. The daily consumption is at present approx. 3,500 m<sup>3</sup> and is anticipated to soon rise to 5,700 m<sup>3</sup>.

By now the town's demand could be satisfied by two reservoirs with 1,200 m<sup>3</sup> capacity each and very good well capacities that have delivered the required quantity from excellent quality groundwater resources. In case of a well or line failure, however, only 800 m<sup>3</sup> drinking water would be available for the consumers. The a. m. 1.200 m<sup>3</sup> cover the required fire water supply of 400 m<sup>3</sup>. The town's water demand could consequently not be guaranteed any more with the two old reservoirs.

That is why they decided to build a bigger reservoir in the district Witzighausen. The new elevated reservoir has been planned by the Swabian engineering office Jellen & Co. that won the tender.

The project volume includes earthworks of approx. 147,000 m<sup>3</sup> and 1,100 m<sup>3</sup> ferro-concrete C25/30xC 4 – C35/45 XF 3 will be built in.

Also stainless steel pipelines DN 250 – DN 500 are required for the hydraulic installations. Construction started on 5 November 2007 and was scheduled to be completed on 31 December 2008.

The whole plant is about 51 x 48 m big and includes four individual water reservoirs, each of them with a capacity of 1.750 m<sup>3</sup> and a diameter of 21 m. For the time being, only two of these reservoirs will be built. These will cover the demand of 3,500 m<sup>3</sup> water. All four reservoirs together will offer a total capacity of 7,000 m<sup>3</sup> drinking water. The maximum flow to the plant during the first stage of construction is 120 l/s, the maximum water withdrawal 240 l/s. With all four reservoirs together, the maximum total flow can in the future be increased to 160 l/s, the maximum withdrawal up to 350 l/s.

HUBER's part in this project has been to supply and install the required stainless steel products, such as pressure doors, safety doors, access doors and manhole covers including ladders, platforms, etc. The customer also ordered HUBER railings to provide the required degree of safety within the structure.

**Related Products:**

- [System Solutions for Drinking Water Storage Tanks](#)
- [Technical Doors, Louvres and Windows](#)
- [Manhole Equipment](#)

**Related Solutions:**

- [HUBER Solutions for Water Storage](#)

---

**Huber Latin America y Cia. Ltda.**  
Eduardo Marquina 3937 of. 708  
Vitacura, Santiago de Chile  
Chile

Tel: +56 2 208 03 34

Email: [info@huber-technology.cl](mailto:info@huber-technology.cl)  
Internet: [www.huber-technology.cl](http://www.huber-technology.cl)

Member of the HUBER group:  
[www.huber.de](http://www.huber.de)